



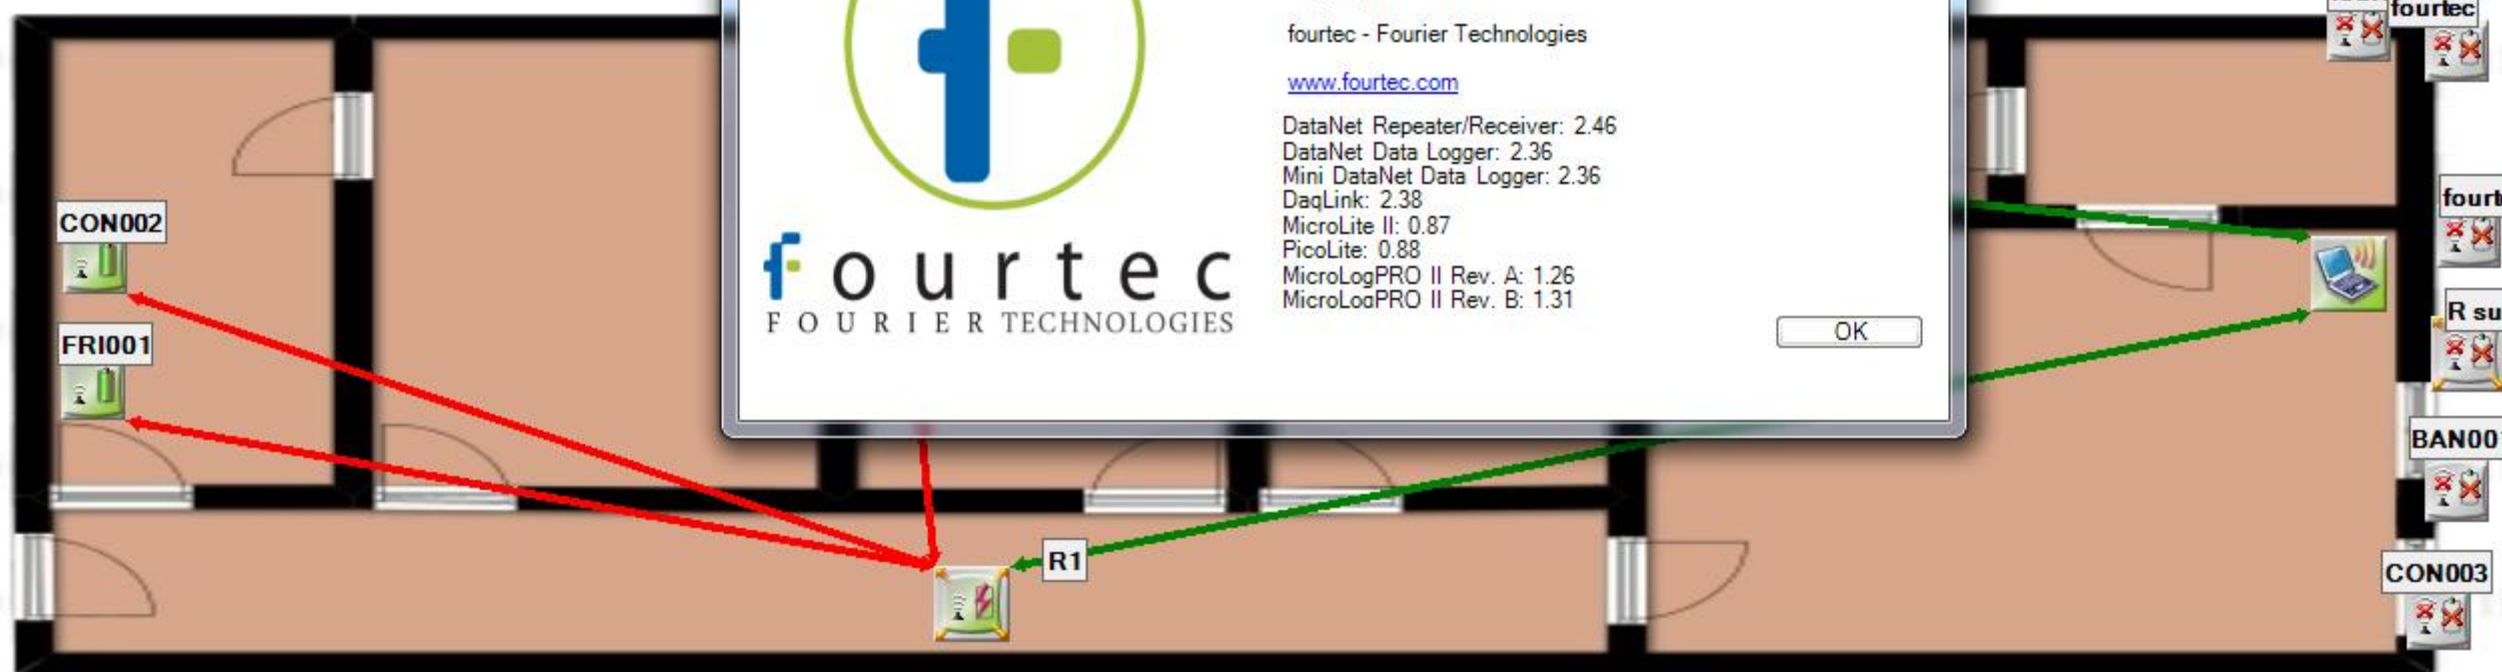


Enter password to enable this feature


Password : 1234



OK Cancel Change Password

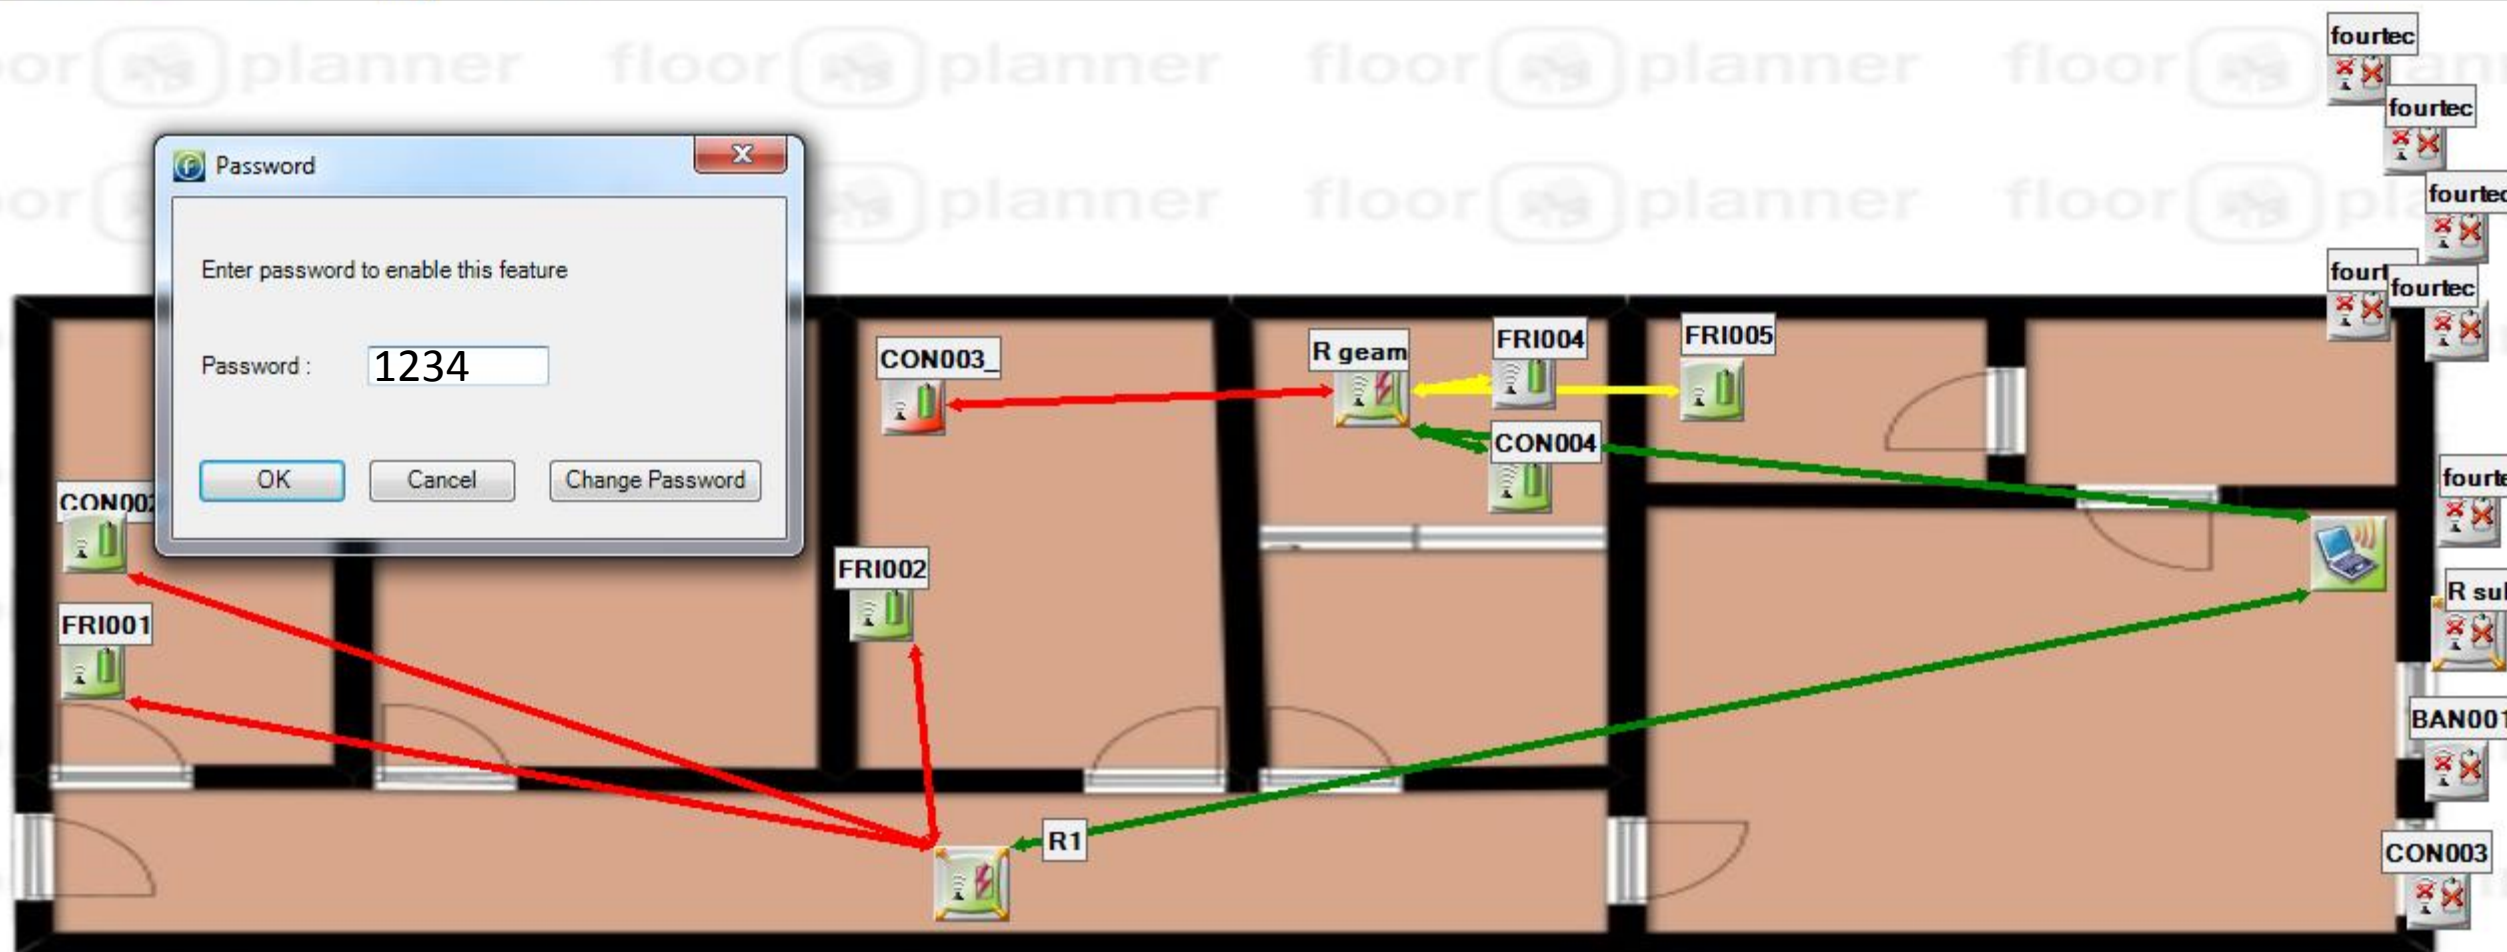



OK Cancel Apply

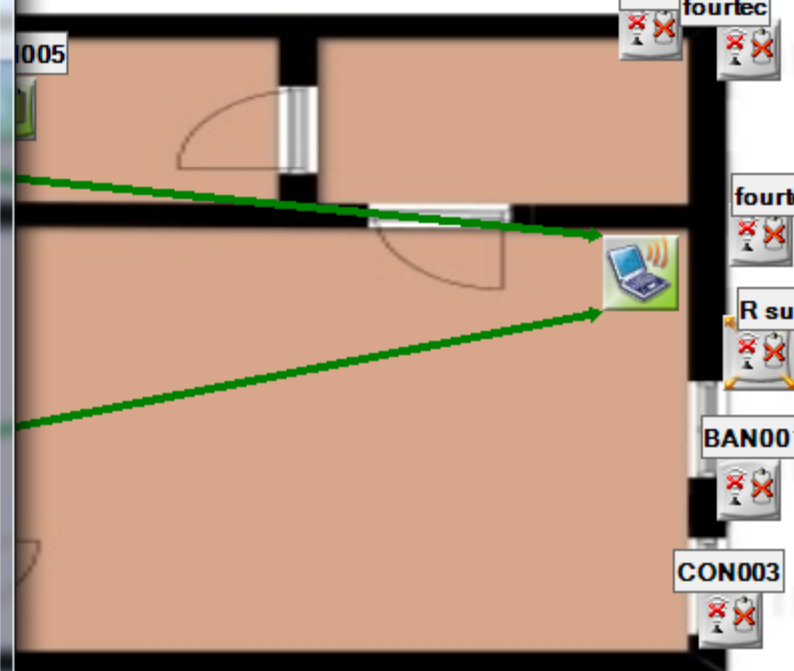

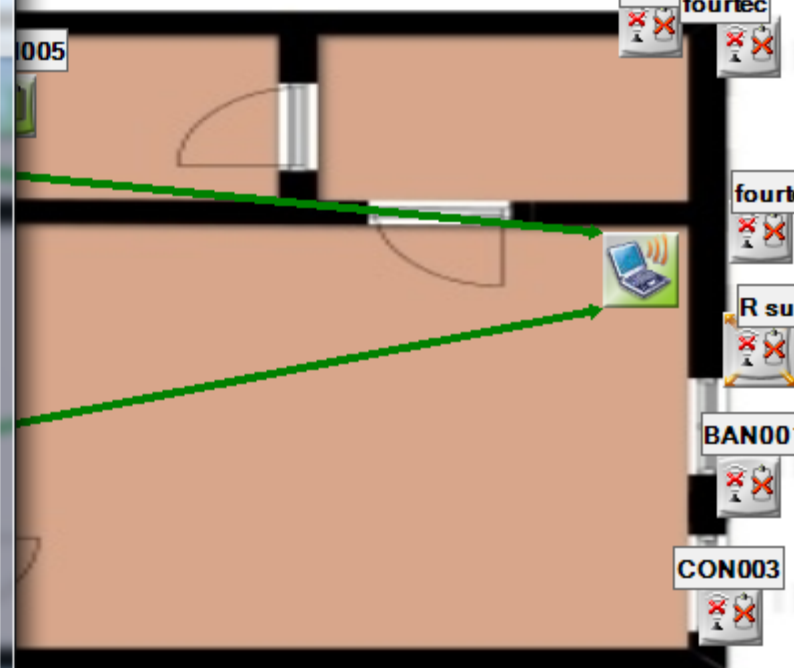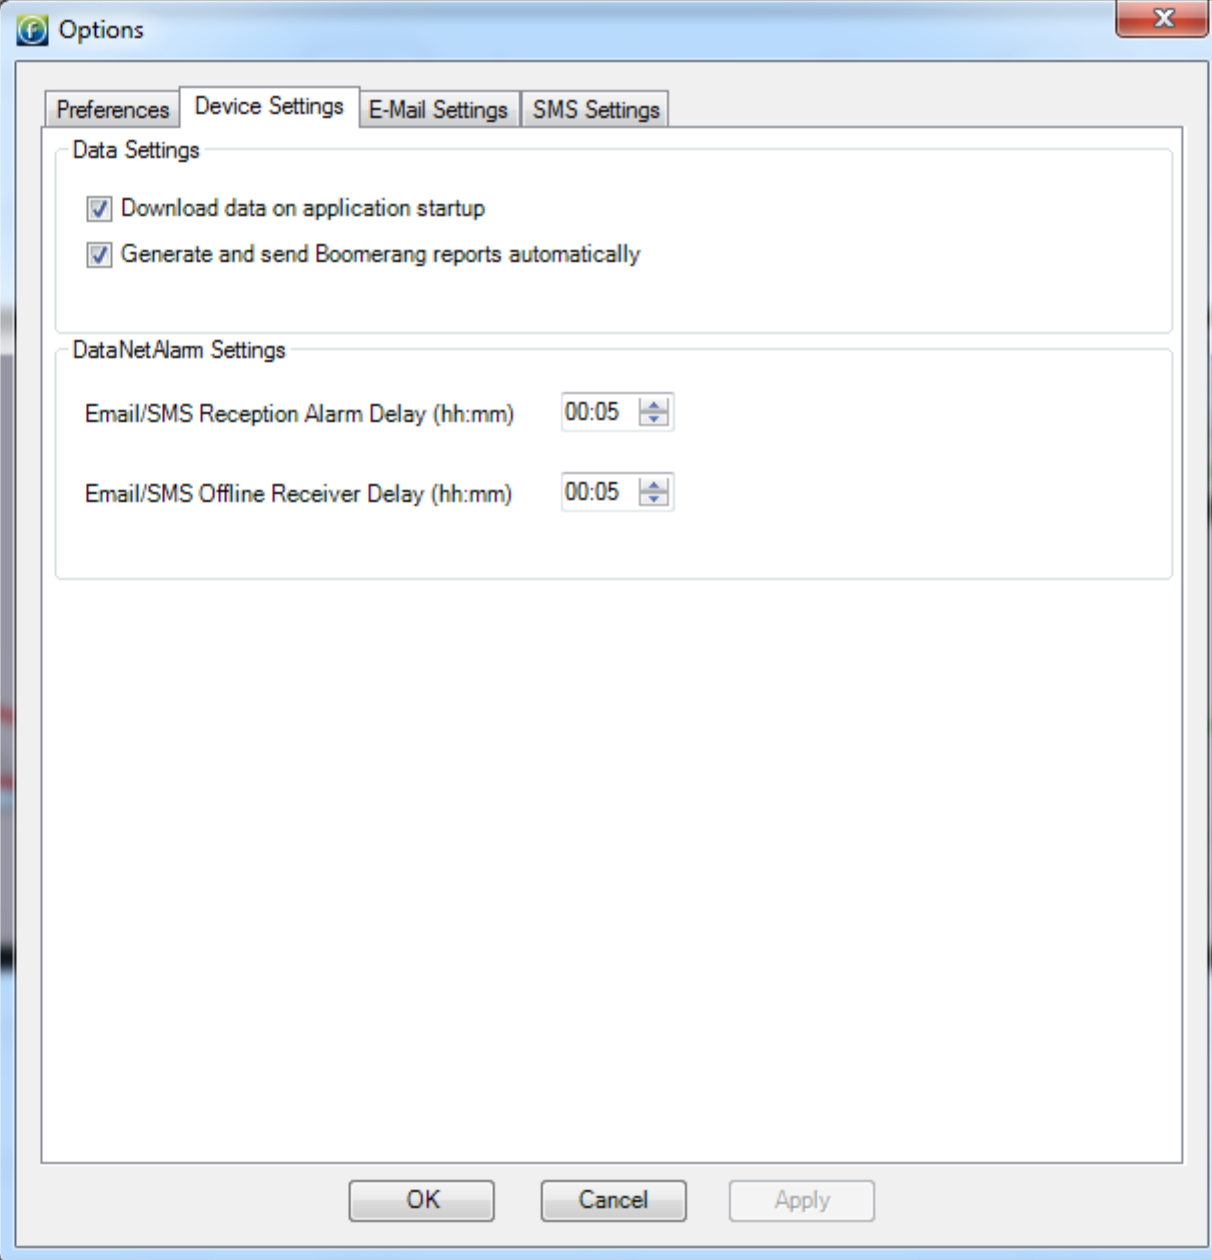



Options

Preferences Device Settings E-Mail Settings SMS Settings

EmailProfileManager

Profile List

Default Profile

LEDOMG

Profile Settings

Profile Name: LEDOMG

Server Information

From: ledomg@lccsms.ro

Server: server-0175.whmpanel.com

Port: 465

Server timeout: 0 seconds

☒ Use authentication login☐ Server requires SSL

Login Information

Username: ledomg@lccsms.ro


Password:

Edit

Test Email

OK

Cancel

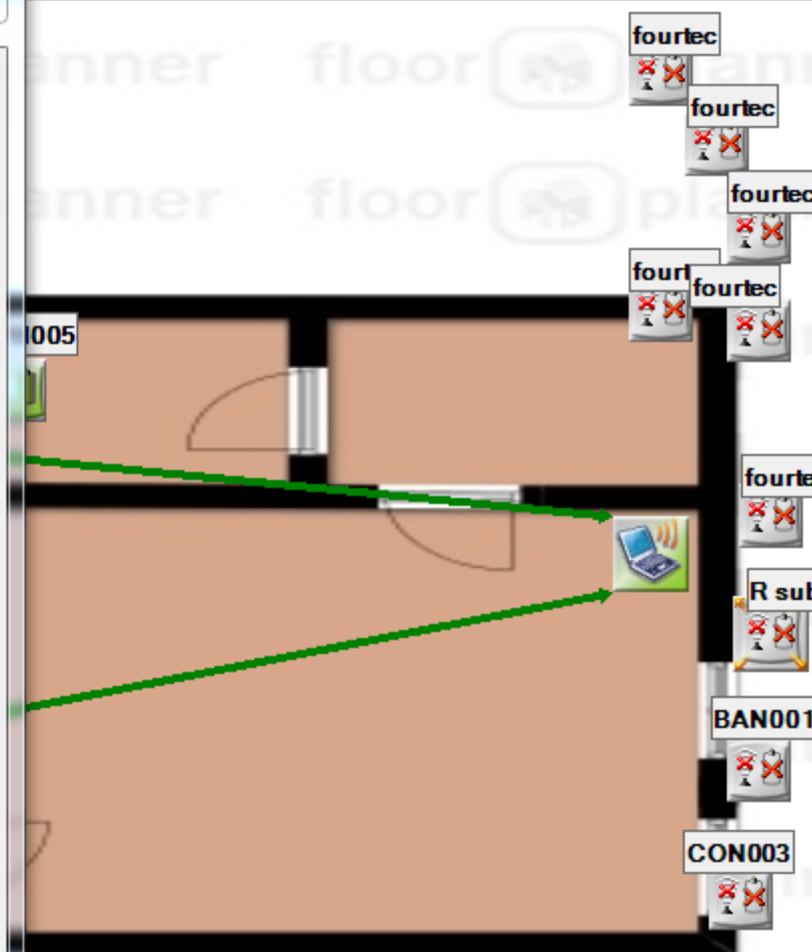



Create New Profile

☒ Enable Report Profile**Boomerang Report Profile**

Raport zilnic

Profile Name: Raport zilnic

Report Generated By: LEDOMG

Report Comment: Buna dimineata!

☒ PDF Header Image Temperature units ☒ °C ☐ °FReport Format: ☐ Excel ☒ PDF A4Sent Report by email ☒ Generated Report

Report Type

☐ Alarm Log☐ Events Log☐ Device Setup Log☐ Device Statistics☐ Sent Email Log☐ Sent SMS Log☐ Received SMS Log☒ Sensors Graph☐ Sensor Histogram

Report Time

Generate Report at 07:30

☒ Daily☐ Weekly on Monday☐ Monthly on 1☐ User Defined

From: 31/10/2013 00:07:55

Until: 01/11/2013 15:07:55

Units


☐ All UnitsOrder: ☐ By S/N ☒ Manual

Index	Check	S/N	Comment
01	☒	100968	CON003_
02	☐	100184	CON003
03	☐	100604	BAN001
04	☒	100859	CON002
05	☒	100570	FRI002
06	☒	100395	FRI005
07	☒	100833	FRI001
08	☐	102038	R subso



Search



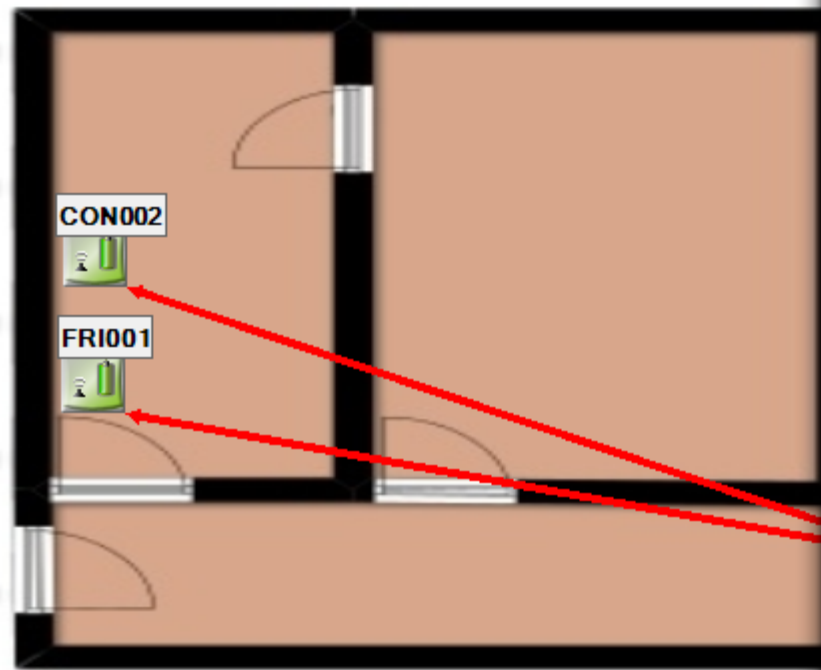

Setup (Running) Network Name: LEDOMG


Device Setup Alarm Setup

Comment:	FRI001	Serial number:	100833
Comment on LCD:	FRI001	Firmware version:	3.4.3.02
Sampling rate (h:m:s)	01:00:00	Battery Level: Good	
Transmissions interval:	0d 01:00:00	Reception Quality: 27%	
Averaging points:	3	Recording time: 898d 15:00:00	

☒ External NTC 10K (DNL808)

Setup and Run Setup Only Close



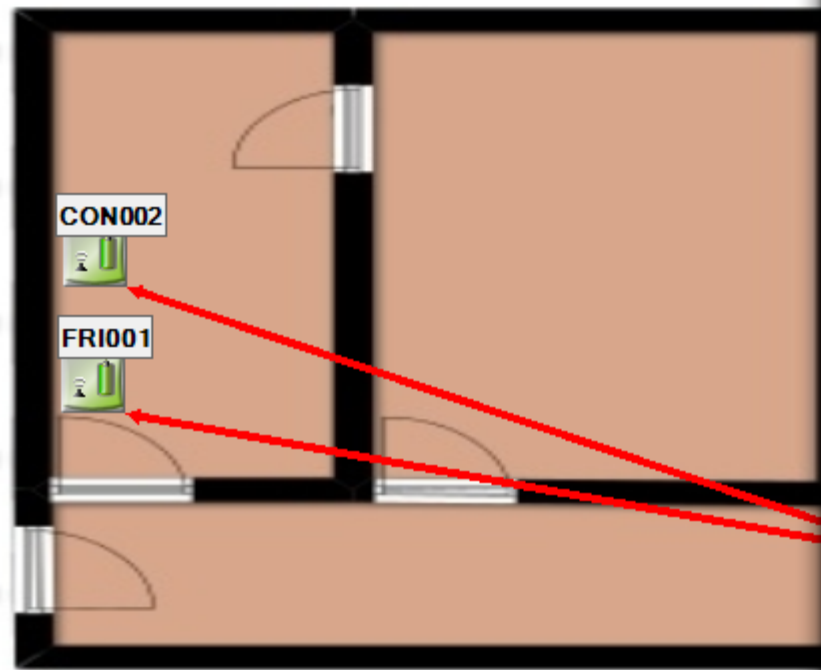

Setup (Running) Network Name: LEDOMG

Device Setup
Alarm Setup

Alarm delay: 00:00:00 (depends on the sampling interval)


Pre-alarm delay: 00:00:00 (depends on the sampling interval)

Alarm duration: 00:00:00

Low Alarm Pre-low Alarm Pre-high Alarm High Alarm

External NTC 10K (DNL808) ☒ 1.00 ☐ 2.00 ☐ 8.00 ☒ 7.00

Setup and Run
Setup Only
Close

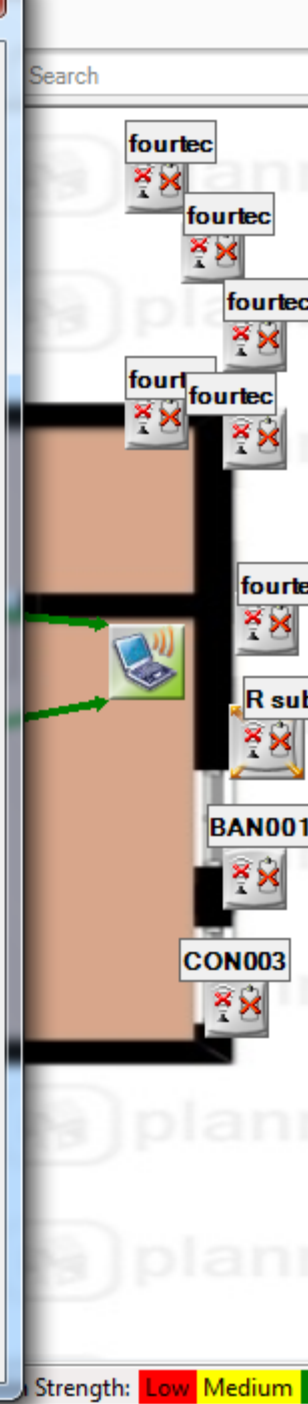



Email Alarm Notifications

Notifications Setup | **Contacts** | Groups

E-Mail

	Low Alarm	Pre-low Alarm	Pre-high Alarm	High Alarm	Normalized	
BAN001 (100604)						
CON002 (100859)						
CON003 (100184)						
CON003_ (100968)						
CON004 (100214)						
fourtec (100060)						
fourtec (100150)						
fourtec (100234)						
fourtec (100548)						
fourtec (100668)						
fourtec (100956)						
FRI001 (100833)	☒	☐	☐	☒	☐	Contacts
FRI002 (100570)						
FRI004 (100067)						
FRI005 (100395)						
R geam (101963)						
R subsol (102038)						
R1 (101800)						
Receiver (701530)						
☐ Battery alarm						Contacts
☐ Reception alarm						Contacts
Check All Uncheck All Contacts						

Close

